



CTAC Overall Program Evaluation




Percentage of Each Question Meeting Requirements in Last 12 Months

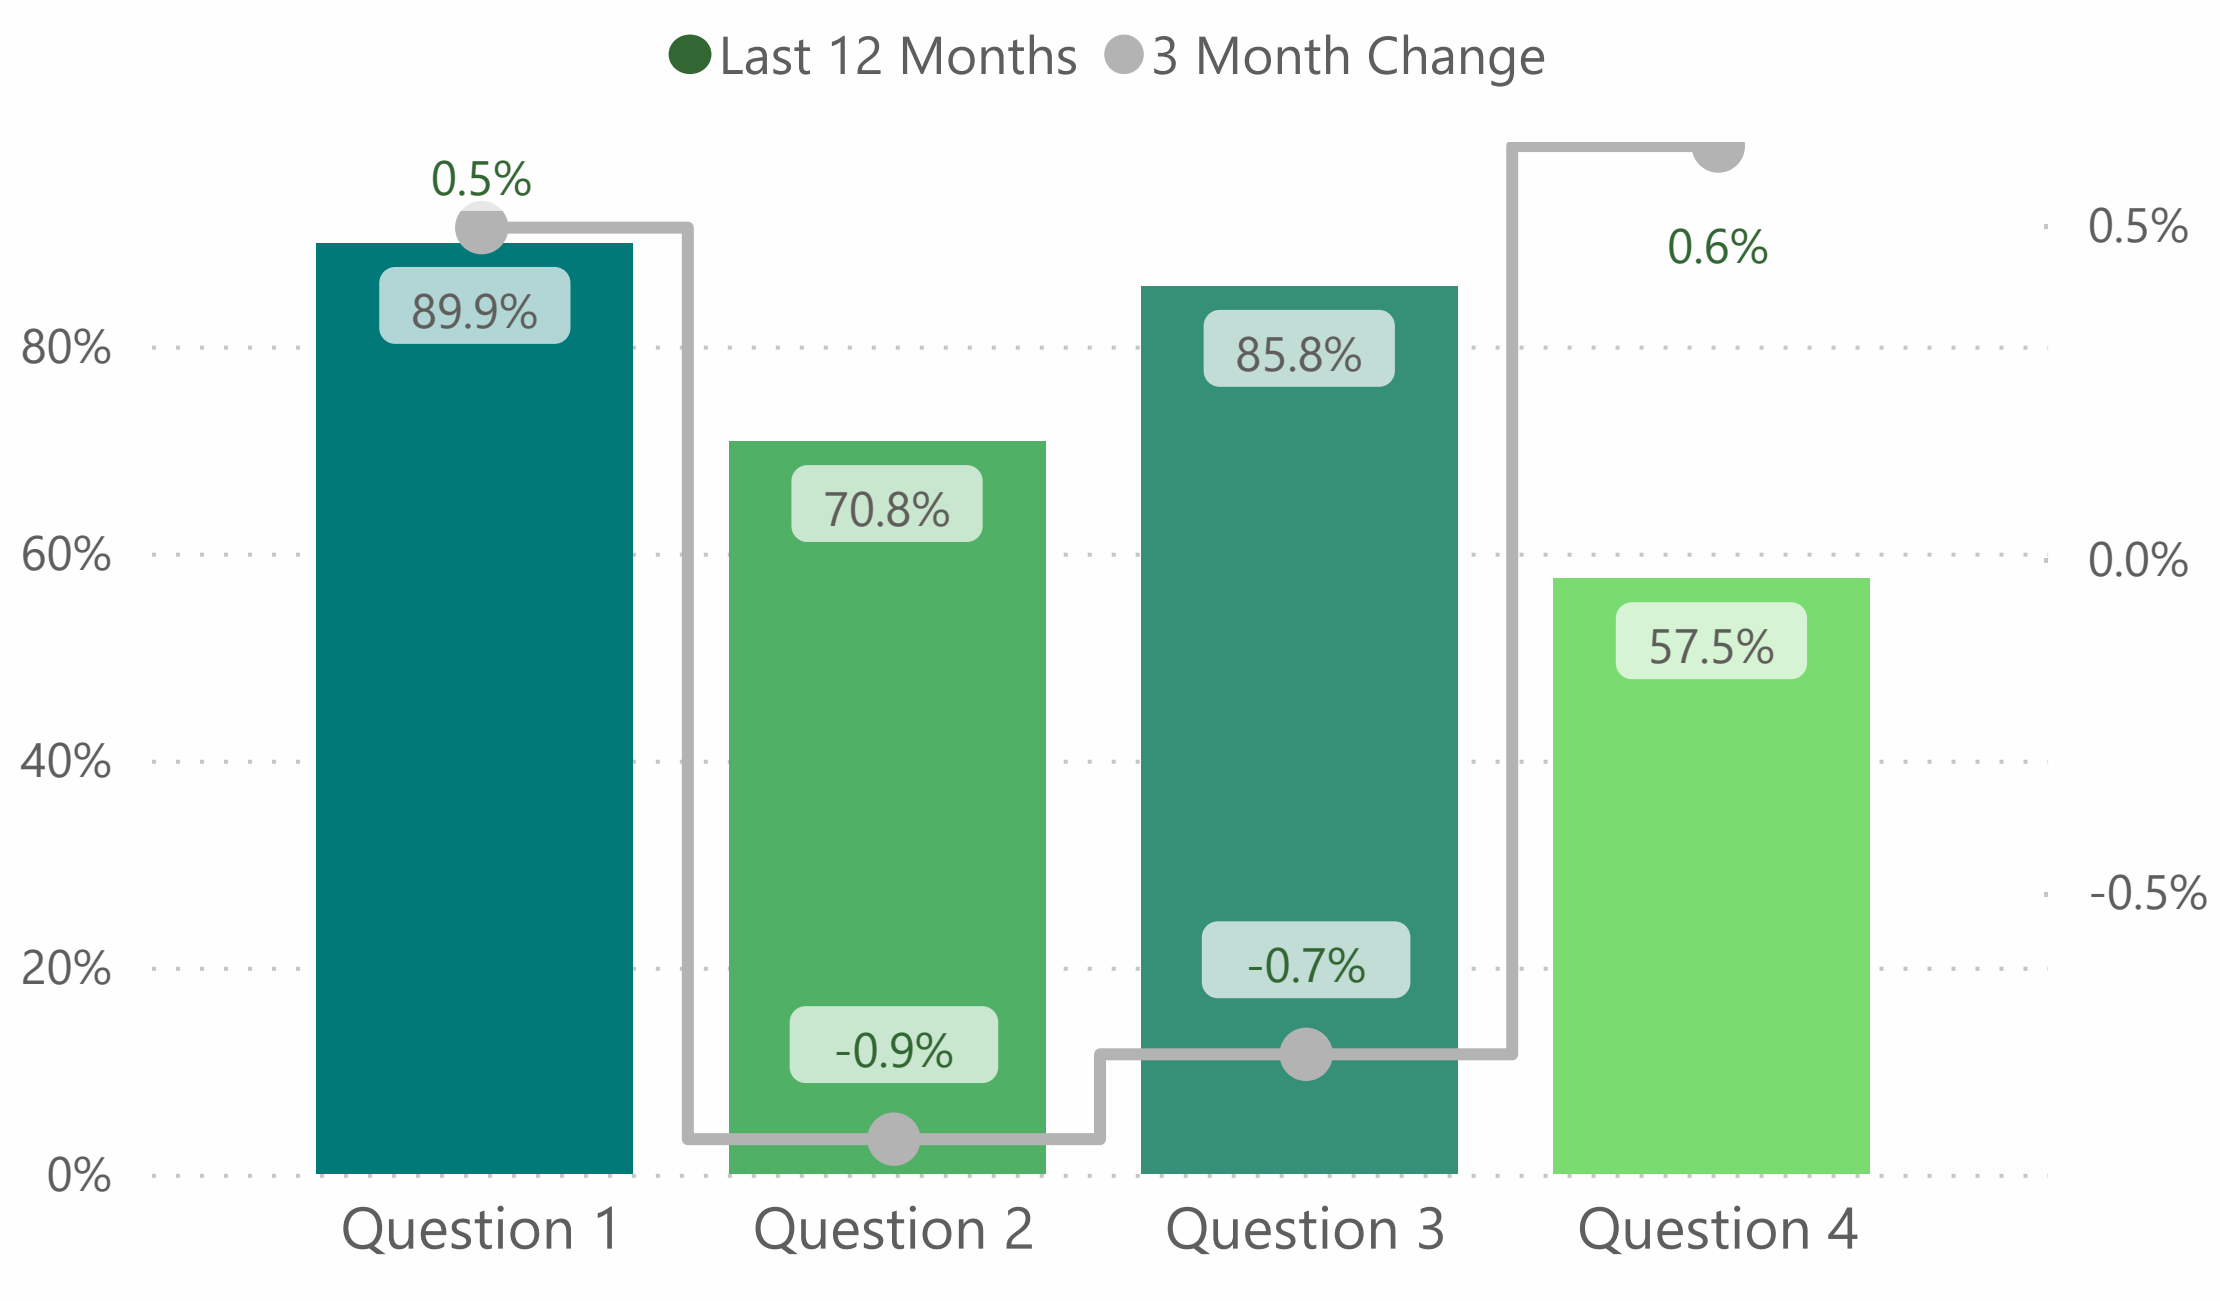

Producer Member Participation

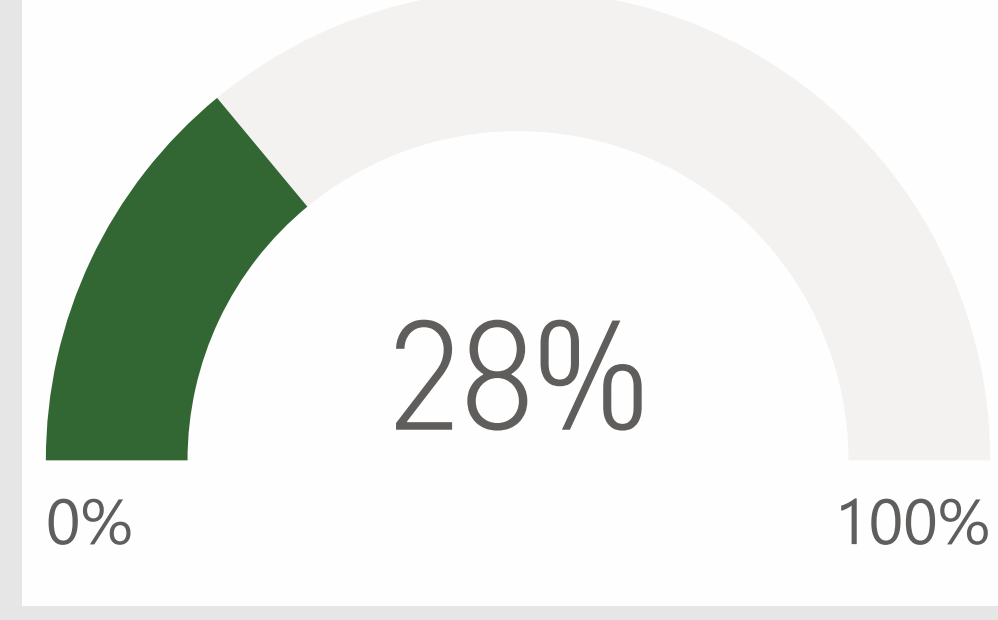


Associate Member Participation

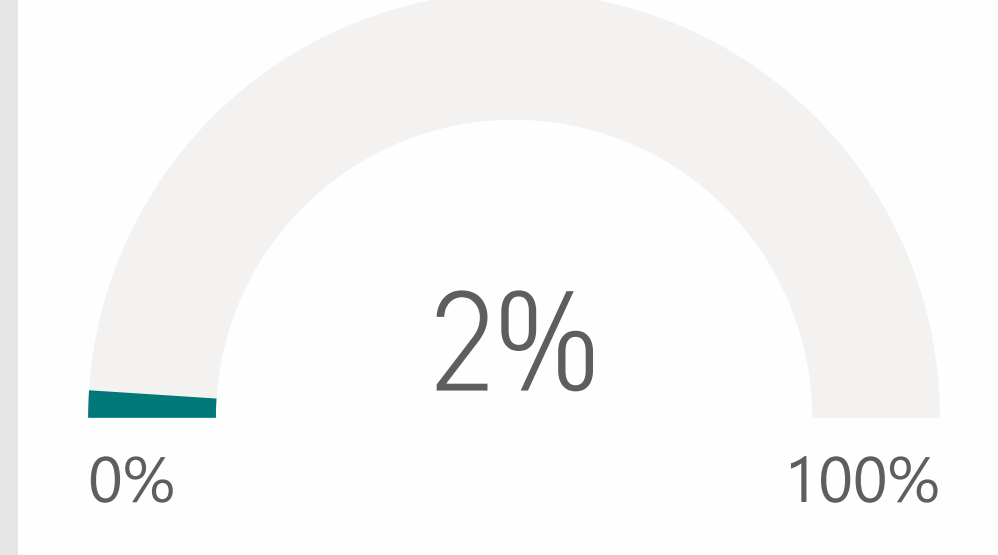

Question	2019	2020	2021	Prev Year Difference
Question 1 Is the testing technician currently ACI Field I certified to test concrete ?	91.1%	89.7%	92.6%	2.9%
Question 2 Excluding preliminary check tests, was the concrete sampled in accordance with ASTM C172?	72.9%	70.1%	78.5%	8.5%
Question 3 Were physical property tests completed and strength specimens molded (if required to cast) in accordance with the appropriate ASTM procedure?	82.8%	85.9%	86.7%	0.8%
Question 4 Were the concrete specimens (if required to cast) stored in an initial curing environment following ASTM C31, section 10.1.2, including temperature monitoring?	48.2%	58.1%	51.2%	-6.9%

Observation of Initial Curing Environment

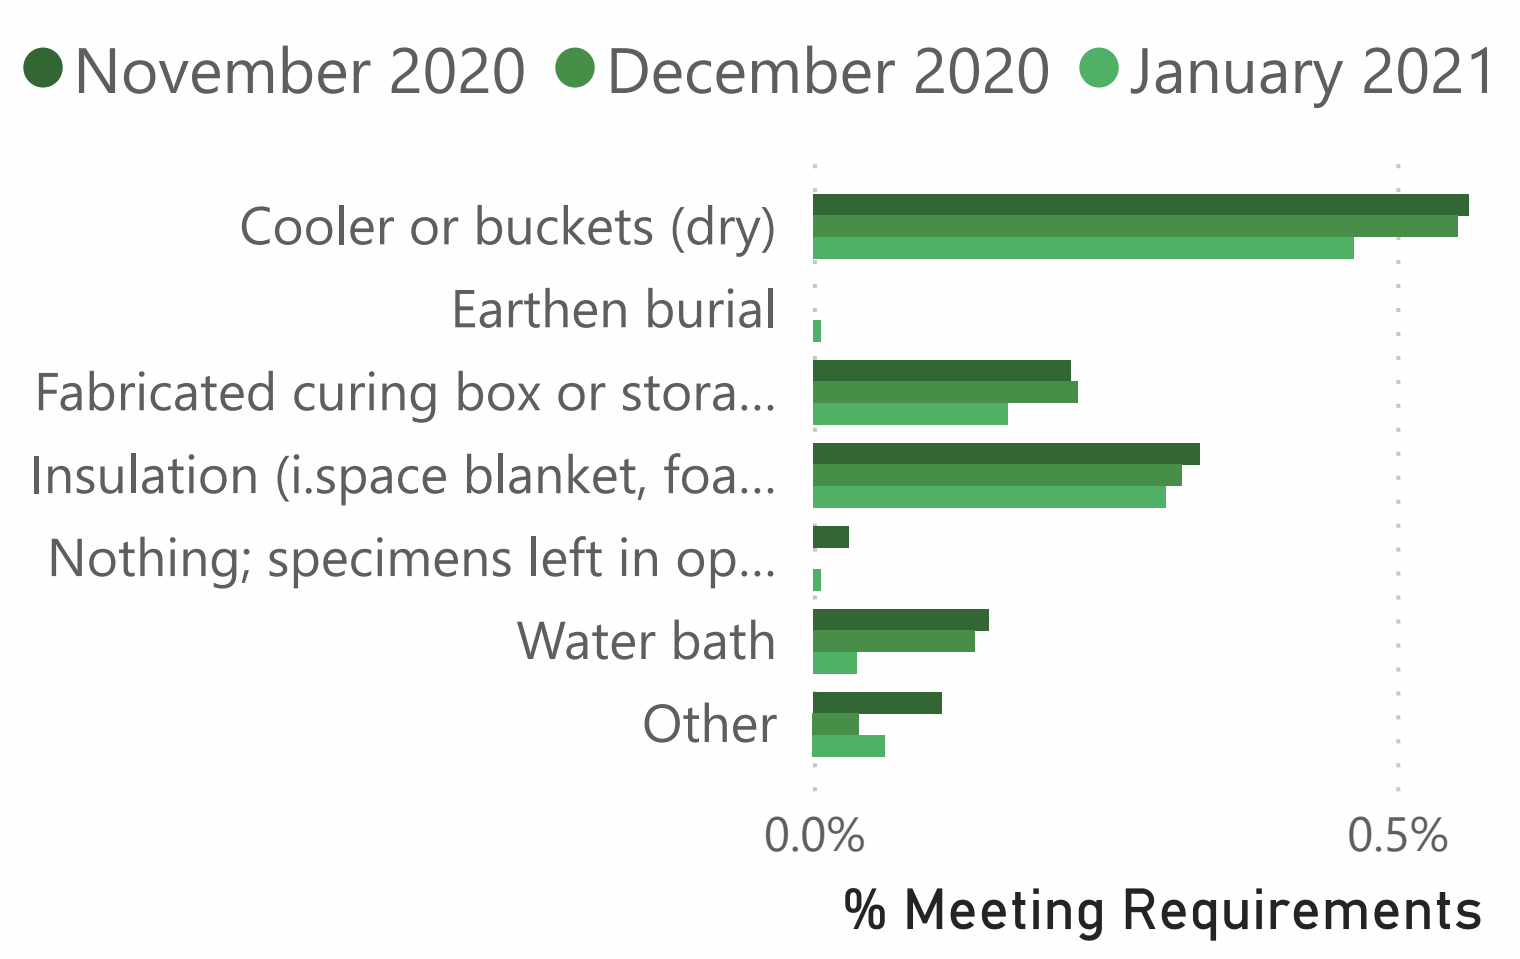

Temperature Monitoring Device Used

