



CTAC Overall Program Evaluation




Percentage of Each Question Meeting Requirements in Last 12 Months

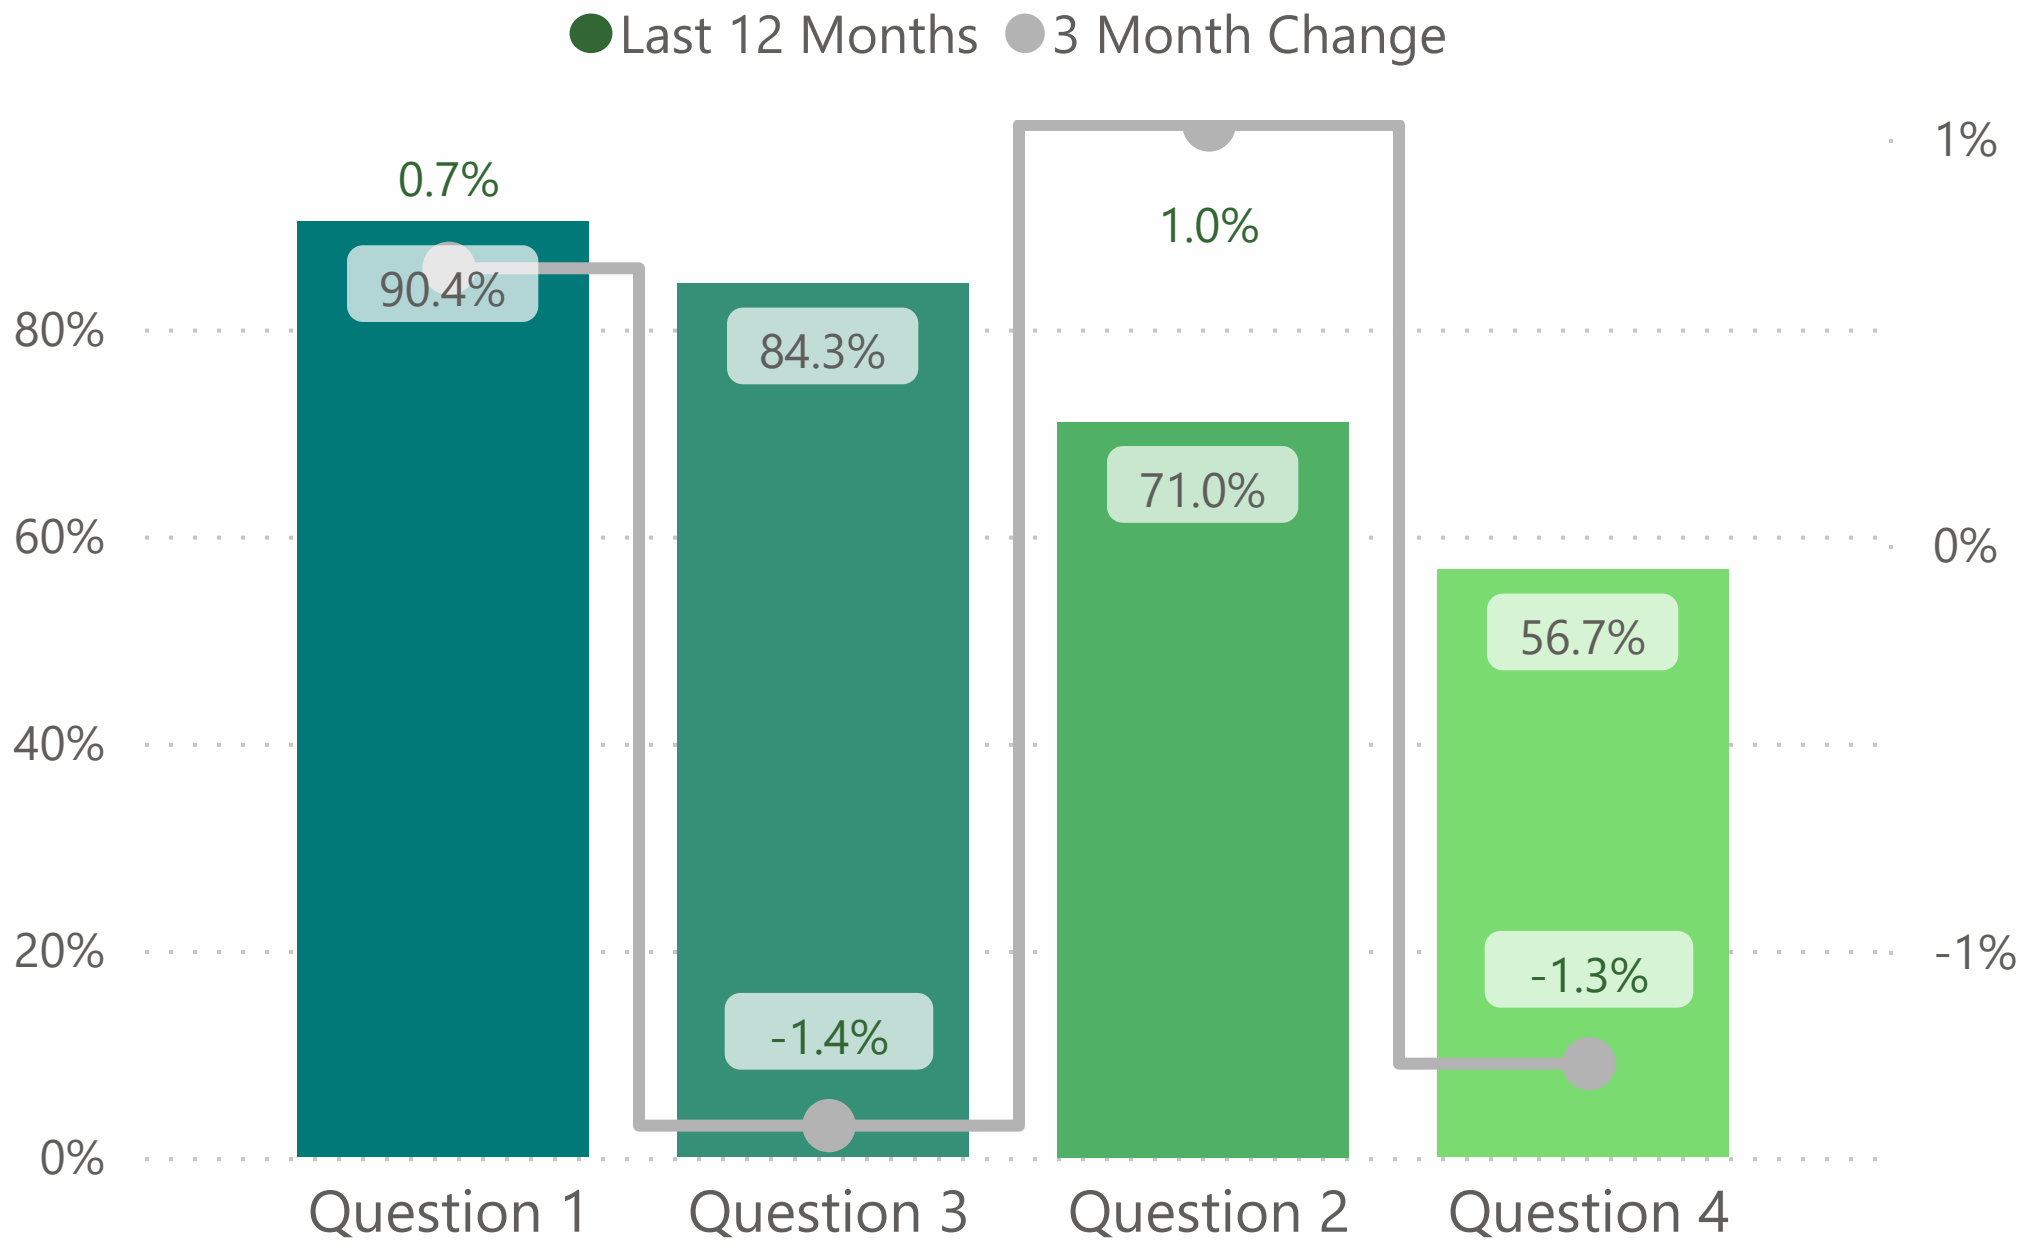

Producer Member Participation

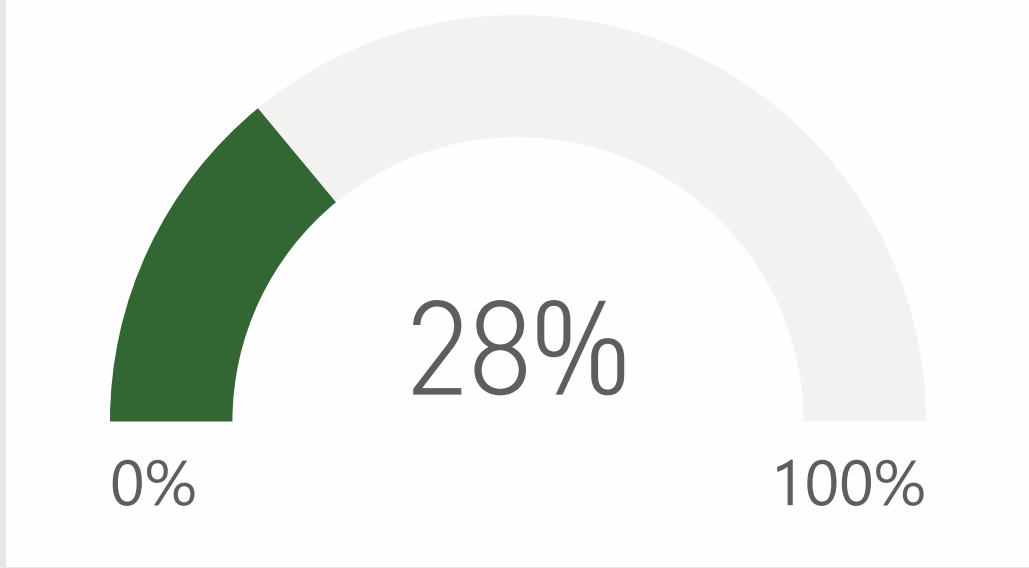


Associate Member Participation

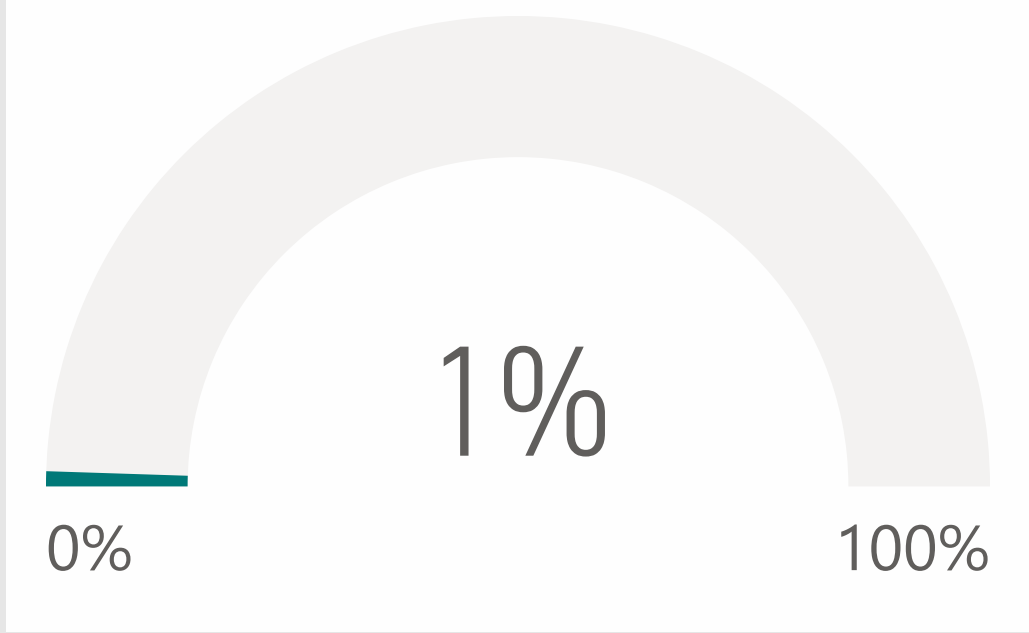


#	Question	2019	2020	2021	Prev Year Difference
Question 1	Is the testing technician currently ACI Field I certified to test concrete ?	89.9%	89.7%	93.8%	4.1%
Question 2	Excluding preliminary check tests, was the concrete sampled in accordance with ASTM C172?	72.7%	70.1%	72.8%	2.7%
Question 3	Were physical property tests completed and strength specimens molded (if required to cast) in accordance with the appropriate ASTM procedure?	85.8%	85.8%	79.5%	-6.3%
Question 4	Were the concrete specimens (if required to cast) stored in an initial curing environment following ASTM C31 section 10.1.2 including temperature	46.1%	58.0%	57.6%	-0.4%

Observation of Field Concrete Testing Procedures

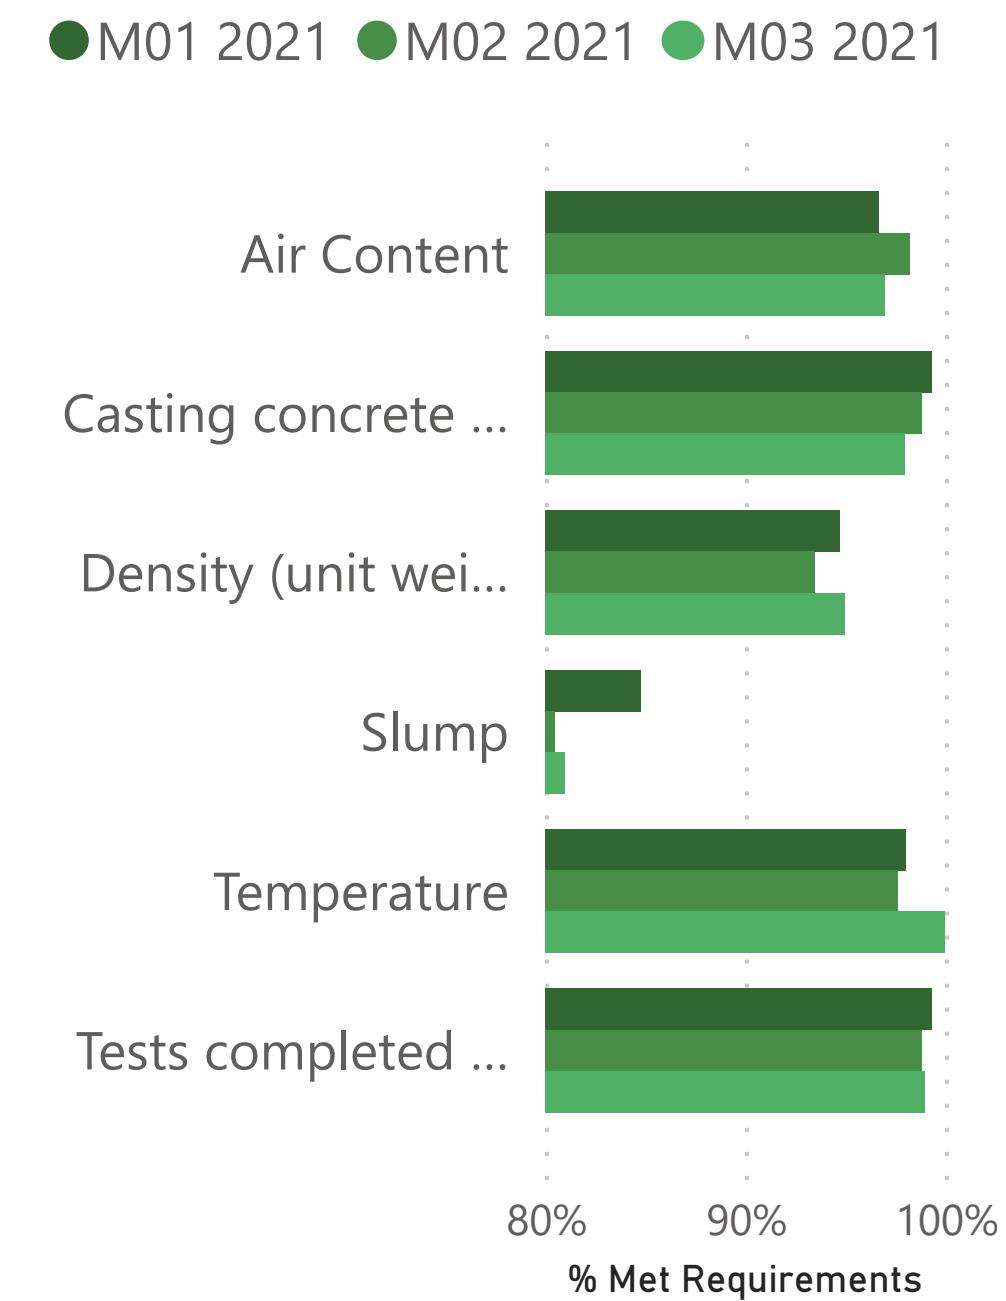

Temperature Monitoring Device Used

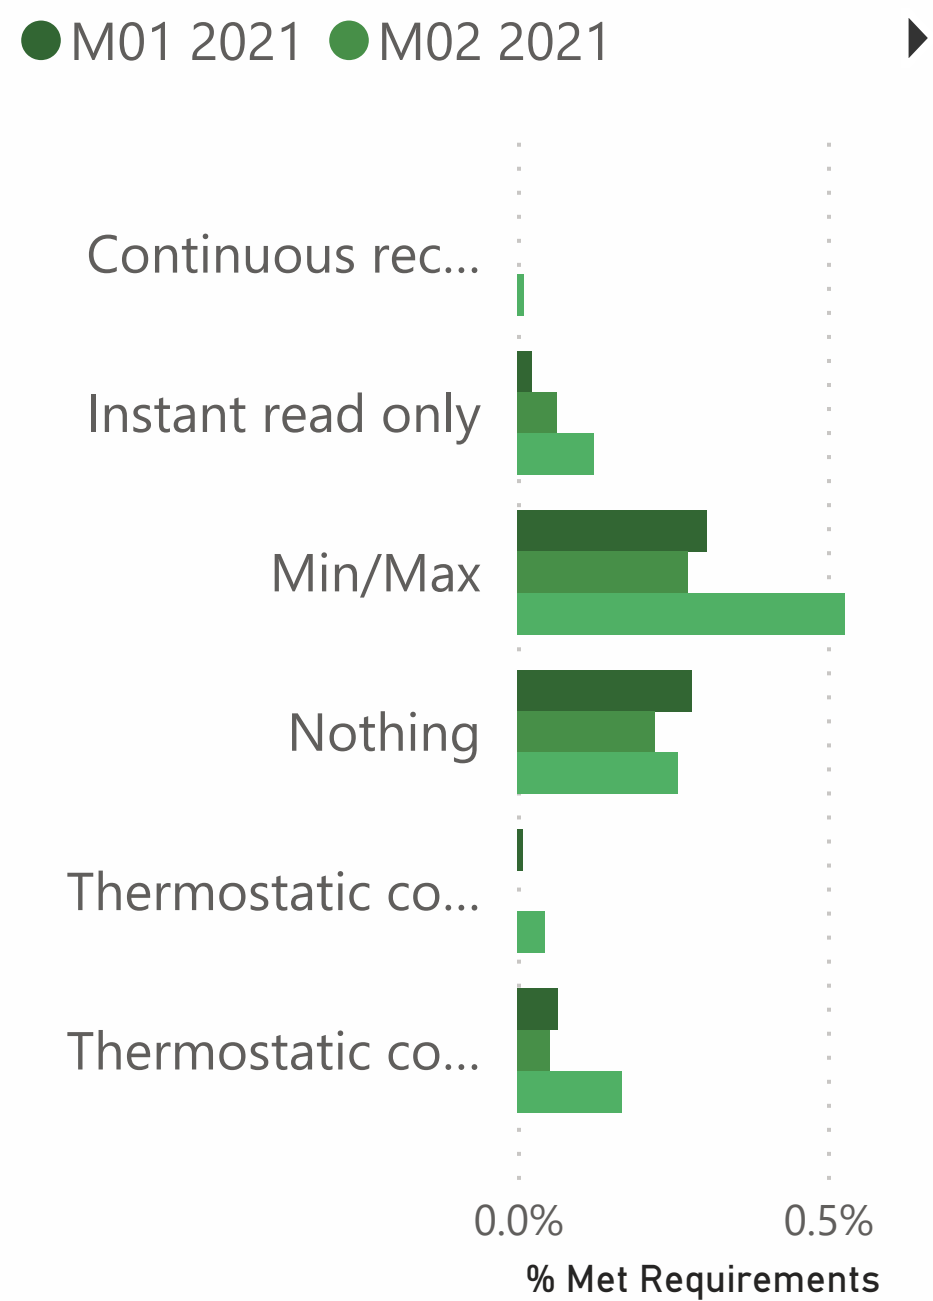

Observation of Initial Curing Environment

