



# CTAC Overall Program Evaluation - March 2021




## Percentage of Each Question Meeting Requirements in Last 12 Months

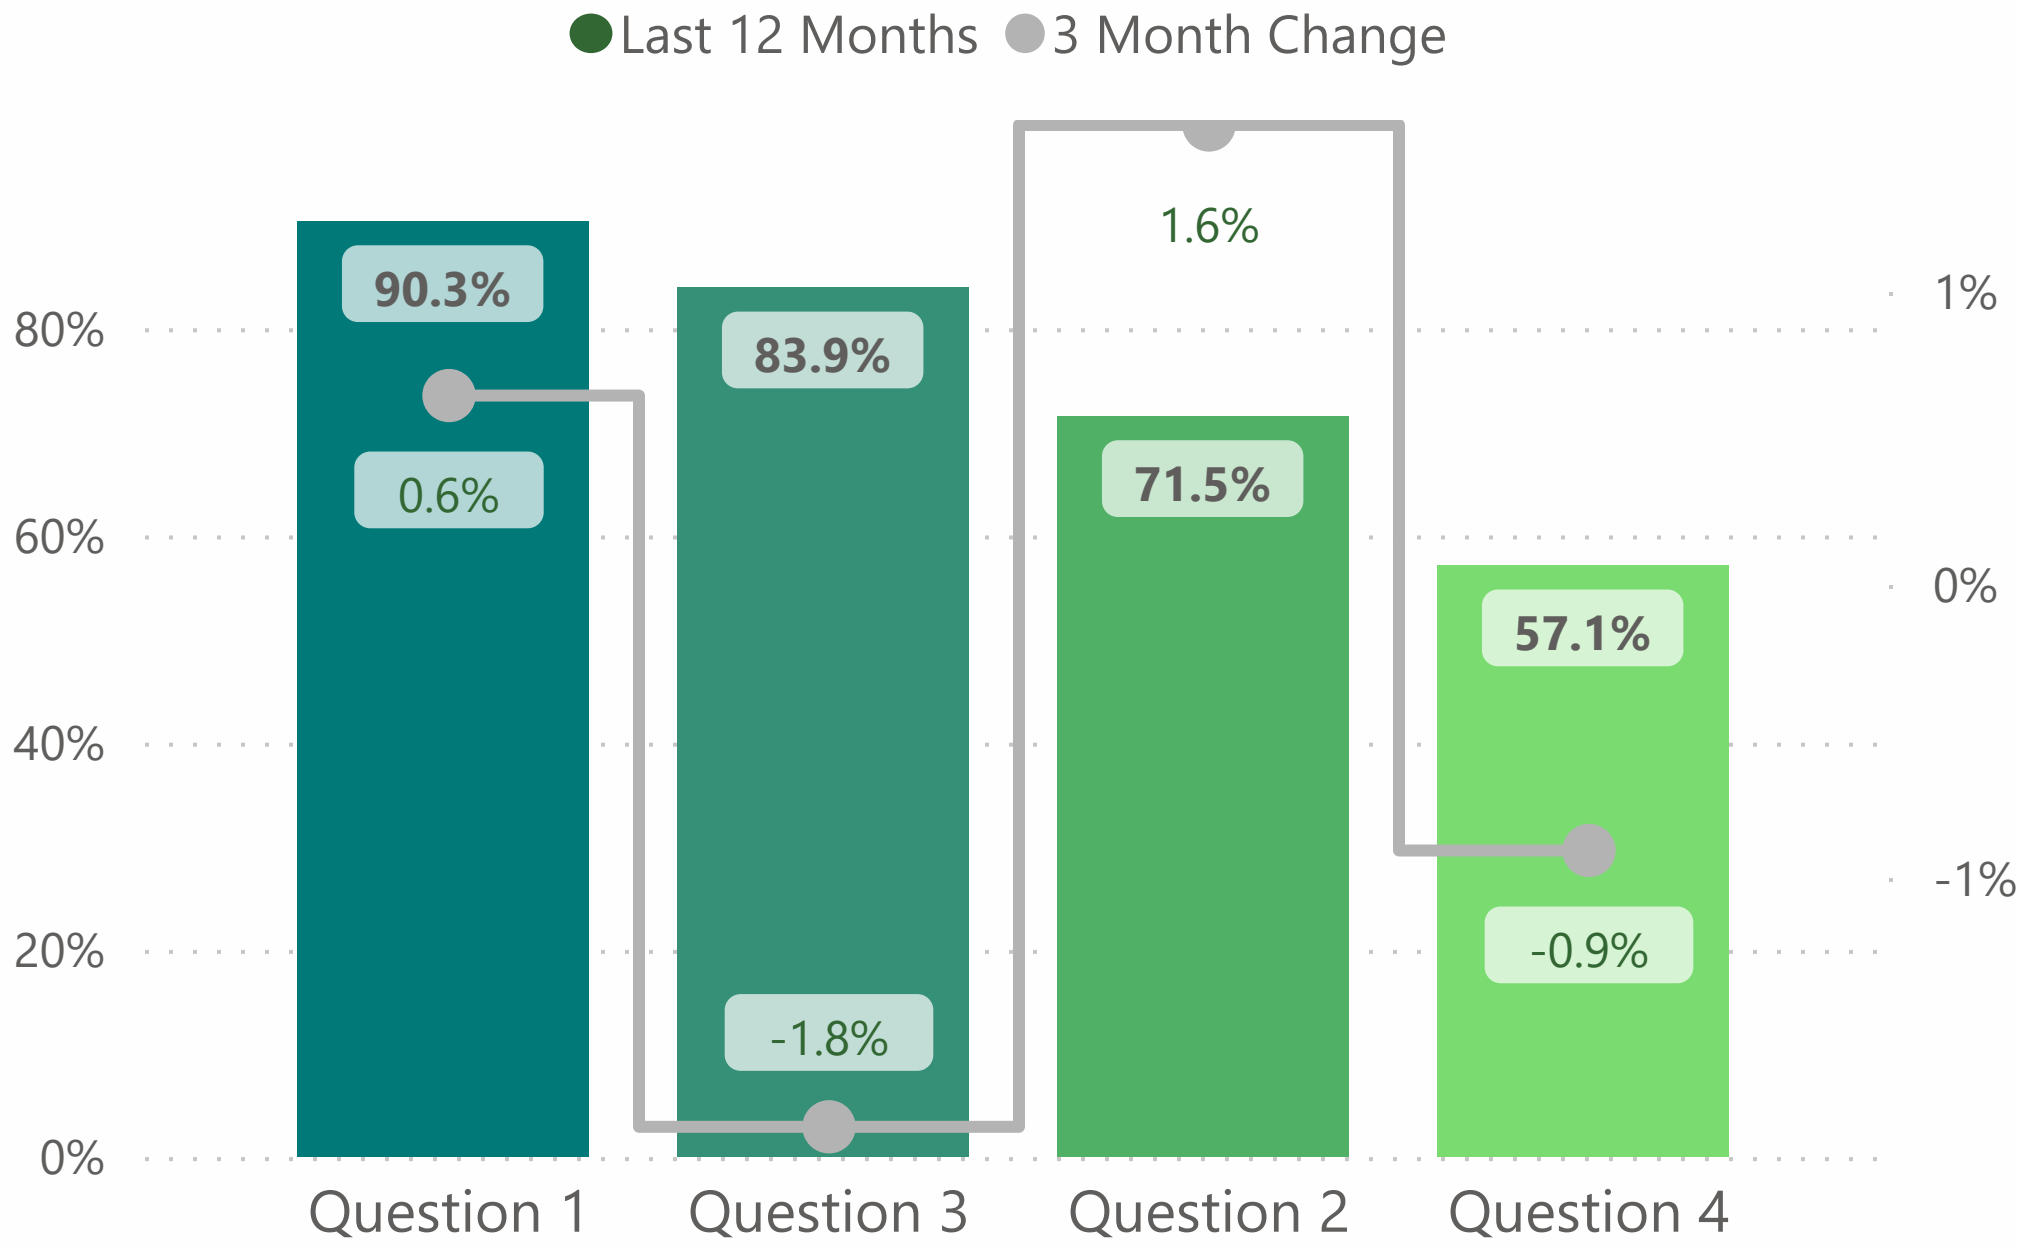

## Producer Member Participation

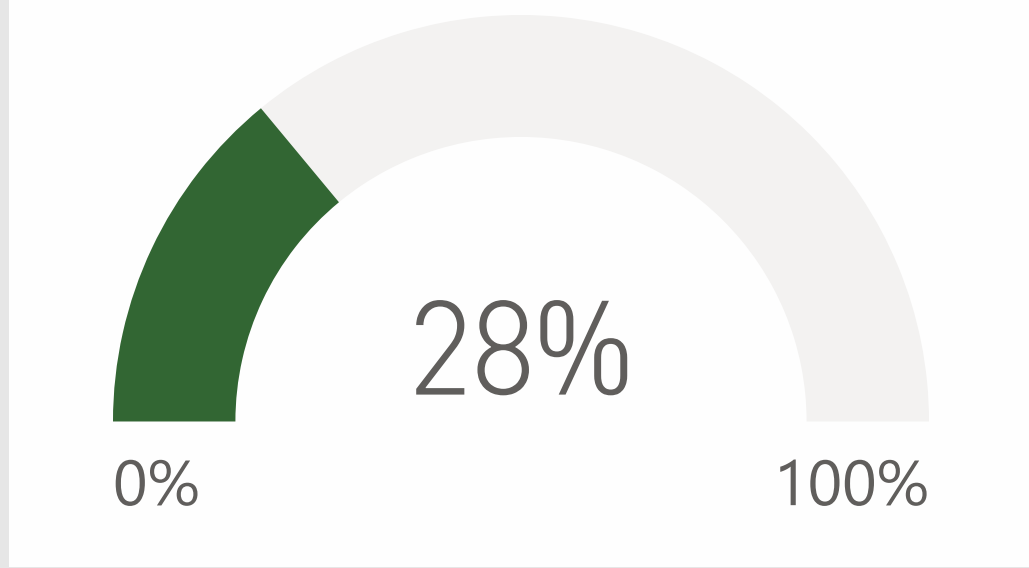


## Associate Member Participation

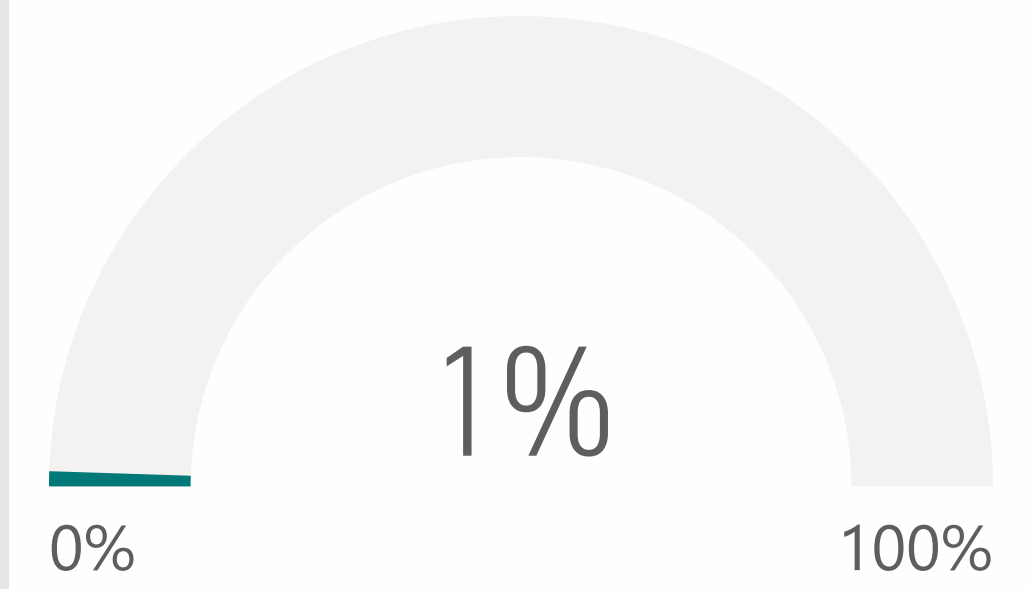

#	Question	2019	2020	2021	Prev Year Difference
Question 1	Is the testing technician currently ACI Field I certified to test concrete ?	89.9%	89.7%	93.7%	<b>4.0%</b>
Question 2	Excluding preliminary check tests, was the concrete sampled in accordance with ASTM C172?	72.7%	70.1%	74.1%	<b>4.0%</b>
Question 3	Were physical property tests completed and strength specimens molded (if required to cast) in accordance with the appropriate ASTM procedure?	85.8%	85.8%	79.3%	<b>-6.5%</b>
Question 4	Were the concrete specimens (if required to cast) stored in an initial curing environment following ASTM C31, section 10.1.2, including temperature monitoring?	46.1%	58.0%	60.8%	<b>2.7%</b>


## Observation of Field Concrete Testing Procedures

● Jan 2021 ● Feb 2021 ● Mar 2021

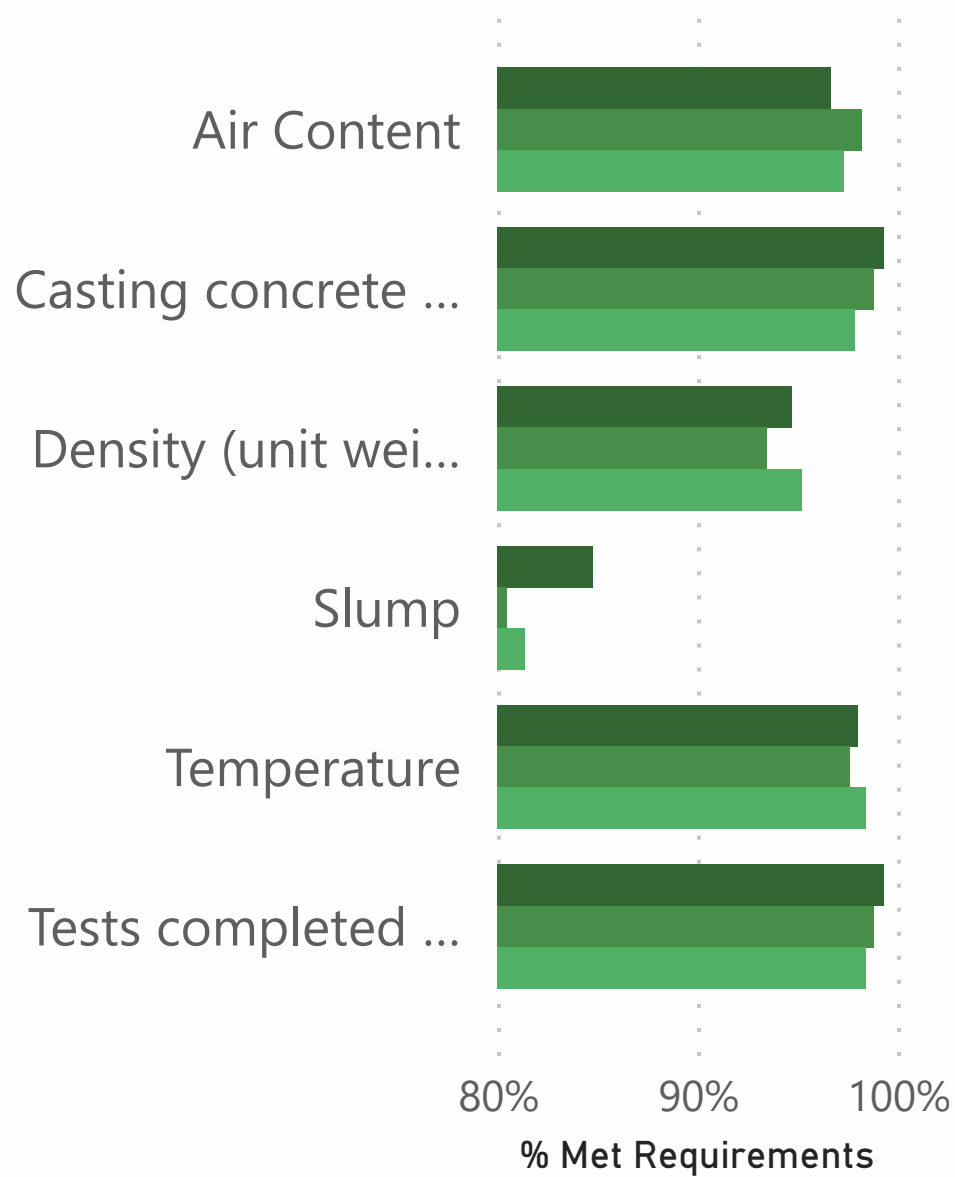

## Temperature Monitoring Device Used

● Jan 2021 ● Feb 2021 ● Mar 2021

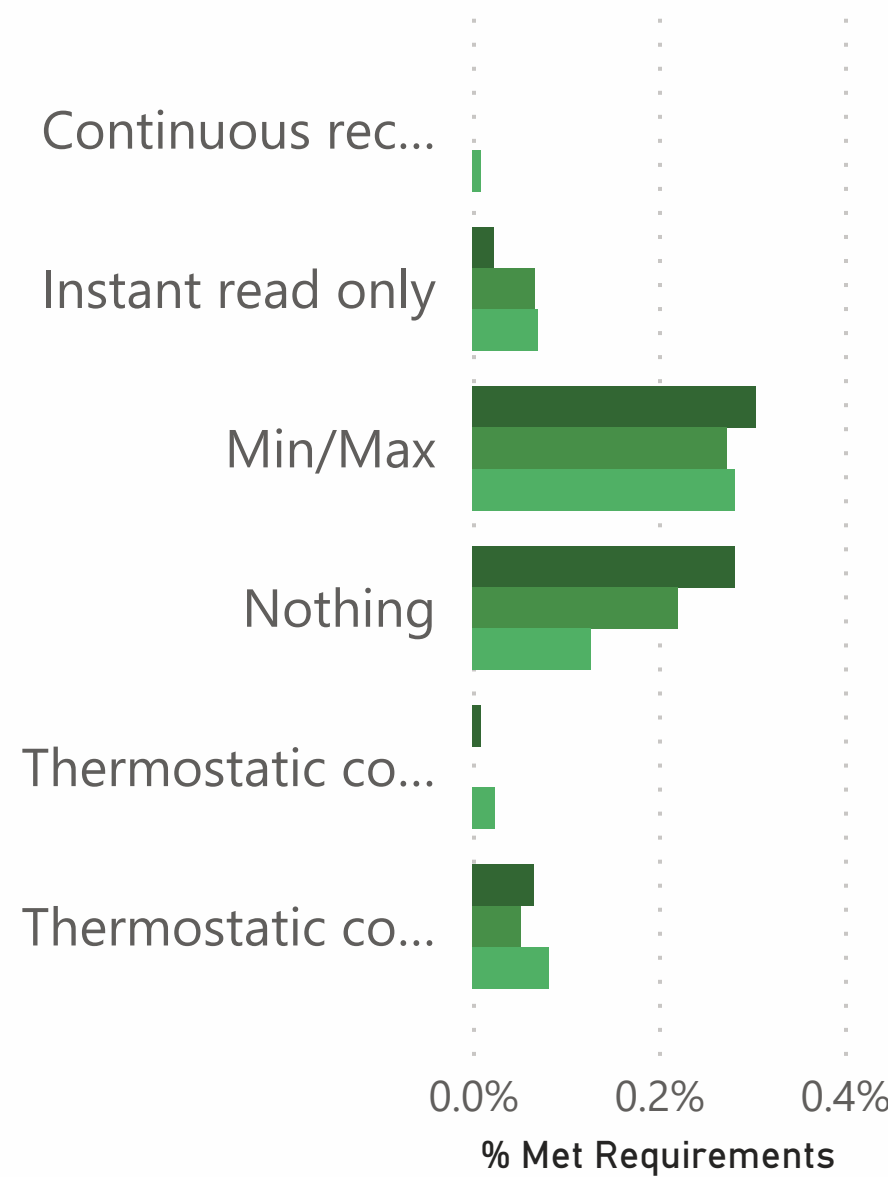

## Observation of Initial Curing Environment

● Jan 2021 ● Feb 2021 ● Mar 2021

