


CTAC Overall Program Evaluation - December 2021




Percentage of Each Question Meeting Requirements in Last 12 Months

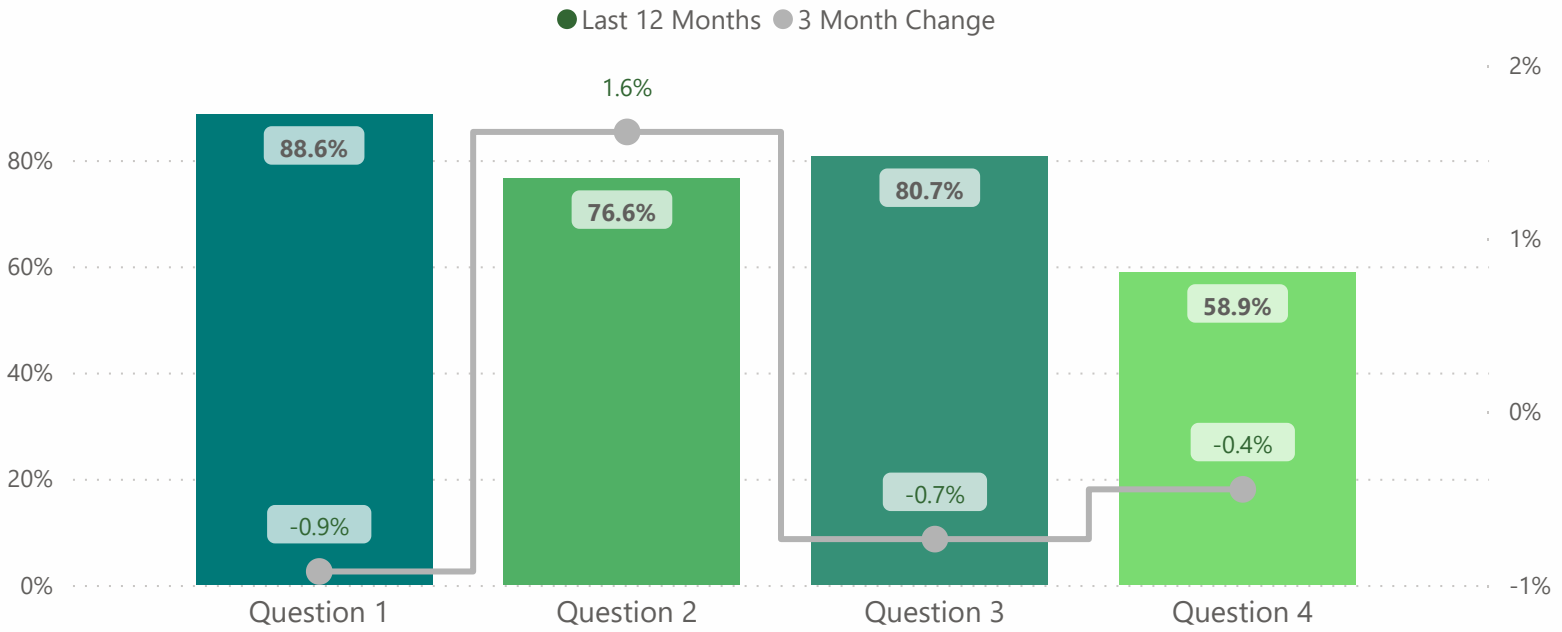

#	Question	2019	2020	2021	Prev Year Difference
Question 1	Is the testing technician currently ACI Field I certified to test concrete ?	91.1%	89.7%	88.6 %	-1.1%
Question 2	Excluding preliminary check tests, was the concrete sampled in accordance with ASTM C172?	72.9%	70.1%	76.5 %	6.5%
Question 3	Were physical property tests completed and strength specimens molded (if required to cast) in accordance with the appropriate ASTM procedure?	82.8%	85.8%	80.7 %	-5.1%
Question 4	Were the concrete specimens (if required to cast) stored in an initial curing environment following ASTM C31, section 10.1.2, including temperature monitoring?	48.2%	58.0%	58.8 %	0.8%


Observation of Field Concrete Testing Procedures

● Oct 2021 ● Nov 2021 ● Dec 2021

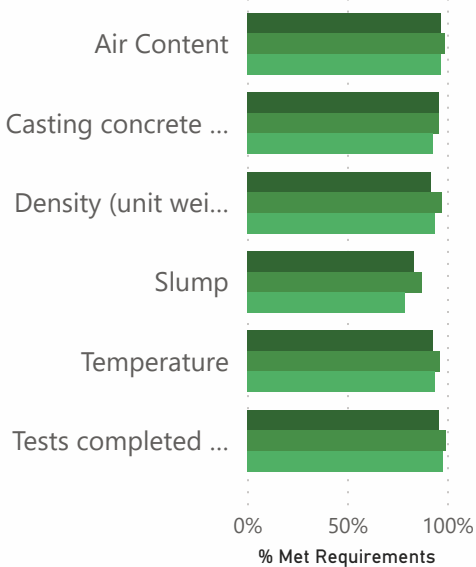

Temperature Monitoring Device Used

● Oct 2021 ● Nov 2021 ● Dec 2021

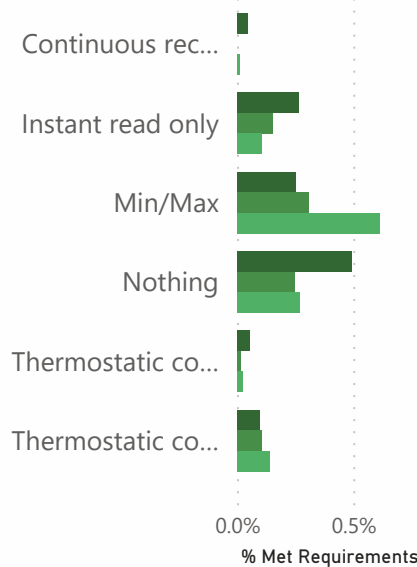

Observation of Initial Curing Environment

● Oct 2021 ● Nov 2021 ● Dec 2021

